



LABORATÓRIO NACIONAL  
DE ENGENHARIA CIVIL

LABORATÓRIO NACIONAL DE ENGENHARIA CIVIL, I. P.  
Av. do Brasil 101 • 1700-066 LISBOA • PORTUGAL  
phone: (351) 21 844 30 00 • fax: (351) 21 844 30 11  
e-mail: [lnecc@lnecc.pt](mailto:lnecc@lnecc.pt) • [www.lnecc.pt](http://www.lnecc.pt)



Member of



[www.eota.eu](http://www.eota.eu)

## European Technical Assessment

**ETA 16/0294**  
of 04/07/2016

English translation prepared by LNEC; original version in Portuguese language

ISSN 2183-3362

Trade name of the construction product

*Designação comercial do produto de construção*

Product family to which the construction product belongs

*Família de produtos a que o produto de construção pertence*

Manufacturer

*Fabricante*

Manufacturing plant(s)

*Instalações de fabrico*

This European Technical Assessment contains

*A presente Avaliação Técnica Europeia contém*

This European Technical Assessment is issued in accordance with Regulation (EU) No. 305/2011, on the basis of

*A presente Avaliação Técnica Europeia é emitida ao abrigo do Regulamento (UE) n.º 305/2011, com base no*

### CIN-k EPS Classic

External Thermal Insulation Composite System with rendering on expanded polystyrene for use as external insulation of building walls

*Sistema Compósito de Isolamento Térmico pelo Exterior com revestimento aplicado sobre isolante térmico de poliestireno expandido moldado destinado ao isolamento exterior de paredes de edifícios*

CIN – Corporação Industrial do Norte, S.A.

Av. de Dom Mendo, 831

Apartado 1008

4471-909 Maia

Portugal

<http://www.cin.pt/>

Av. de Dom Mendo, 831

Apartado 1008

4471-909 Maia

Portugal

14 pages, including 2 annexes which form an integral part of the assessment

*14 páginas, incluindo 2 anexos que fazem parte desta avaliação*

Guideline for European Technical Approval (ETAG) No. 004, edition 2013, used as European Assessment Document (EAD)

*Guia de Aprovação Técnica Europeia (ETAG) n.º 004, edição de 2013, utilizado como Documento de Avaliação Europeu (EAD)*

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission according to Article 25, Paragraph 3, of Regulation (EU) No. 305/2011.

## 1. Technical description of the product

The External Thermal Insulation Composite System (from now on, referred to as ETICS) *CIN-k EPS Classic* is designed and installed in accordance with the ETA holder's design and installation instructions, deposited with LNEC<sup>1</sup>.

*CIN-k EPS Classic* is a bonded system with supplementary mechanical fixings used primarily to provide stability until the adhesive has dried and increase the adherence of the system reducing the risk of detachment.

The ETICS comprises the components identified in Table 1, which are factory produced by the ETA holder or by a supplier.

It is made up on site from these components. The ETA holder is ultimately responsible for the ETICS.

## 2. Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

This ETICS is intended to be used as external thermal insulation for building walls. The walls are made of masonry (bricks or blocks) or concrete (cast on site or as prefabricated panels) with a reaction to fire classification A1 to A2-s2,d0 according to EN 13501-1 or A1 according to the EC decision 96/603/EC as amended. The ETICS is designed to give the wall to which is applied satisfactory thermal insulation.

The ETICS is made of non load-bearing construction elements. It does not contribute directly to the stability of the wall on which is installed, but it can contribute to its durability by providing enhanced protection from the effect of weathering. The thermal resistance of the ETICS shall be  $\geq 1,0 \text{ m}^2 \text{ K/W}$ .

This ETICS can be used on new or existing (retrofit) vertical walls. It can also be used on horizontal or inclined surfaces which are not exposed to precipitation.

The ETICS is not intended to ensure the air tightness of the building structure.

Design and installation of ETICS should take into account the principles laid down in chapter 7 of ETAG 004 and shall be done in accordance with national instructions. This ETA covers the application of bonded ETICS where the concrete for testing of bond strength is representative for masonry or concrete. For bonded applications onto other substrates (e.g. organic paints or ceramic tiles), testing on the job site is necessary.

The provisions made in this ETA are based on an assumed working life of at least 25 years, provided that the conditions laid down for the installation, appropriate use, maintenance and repair are met.

The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right product in relation to the expected economically reasonable working life of the works.

### Installation

The ETICS is installed on site. It is the responsibility of the ETA holder to guarantee that the information about design and installation of this ETICS is effectively communicated to the concerned people. This information can be given using reproductions of the respective parts of this European Technical Assessment. Besides, all the data concerning the execution shall be clearly indicated on the packaging and/or the enclosed instruction sheets using one or several illustrations.

The wall on which the ETICS is applied shall be sufficiently stable and airtight. Its stiffness shall be big enough to ensure that the ETICS is not subjected to deformations, which could lead to damage. The requirements given in ETAG 004, chapter 7, have to be considered.

<sup>1</sup> The technical documentation of this European Technical Assessment is deposited with Laboratório Nacional de Engenharia Civil (LNEC) and, as far as relevant for the tasks of the notified body (bodies) involved in the assessment and verification of constancy of performance procedure, is handed over to the notified body (bodies).

**TABLE 1**  
Definition of the components

Components	Trade name	Description <sup>1</sup>	Coverage (kg/m <sup>2</sup> )	Thickness (mm)	
Insulation product	POLIESTIRENO EXPANDIDO 100	Expanded polystyrene (EPS) Panels with 1000 mm x 500 mm and bulk density of 21 kg/m <sup>3</sup> , with CE marking	–	40 to 60	
Adhesive	PRINCOL ARGAMASSA FIBRADA	Mortar based on cement, synthetic resins and mineral additives	3 to 3.5	–	
Base coat	PRINCOL ARGAMASSA FIBRADA	Mortar based on cement, synthetic resins and mineral additives	with standard glass fibre	4 to 5 (including regularization coat)	1.5 to 3.5
			with reinforced glass fibre	7.5 to 9 (including regularization coat)	3.5 to 5.5
Finishing coats	F1a	PRIMÁRIO TEXTURADO	Textured watery dispersion key coat	0.15 to 0.20	0.5 to 1
		CARSO 1 <sup>3</sup>	Synthetic thin render based on watery dispersion of a co-polymer, marble particles with selected grain sizes and pigments	2 to 2.5	
	F1b	PRIMÁRIO TEXTURADO	Textured watery dispersion key coat	0.15 to 0.20	0.5 to 1
		ERALIT <sup>3</sup>	Synthetic thin render based on watery dispersion of a co-polymer, marble particles with selected grain sizes and pigments	2 to 2.5	
	F2	ARGAMASSA AREADA	Dry mortar with grainy finishing	1.4 to 1.7	0.9 to 1
		NOVATEX HD	Acrylic paint forming a sandy film, reinforced with quartz	0.7 to 0.9	
Glass fibre meshes	FAST TELA F167	Standard mesh (glass fibre mesh with mesh size 5 mm x 4 mm) (in accordance with Agrément Certificate DH 918 by LNEC)	–	–	
	FAST TELA F300	Reinforced mesh (glass fibre mesh with mesh size 6 mm x 6 mm) (in accordance with Agrément Certificate DH 918 by LNEC)	–	–	
Anchors (supplementary mechanical fixings)	PREGO DE FIXAÇÃO TDS 8	Description in accordance with ETA 04/0030 <sup>2</sup> Remain under the ETA holder responsibility	–	–	
Ancillary materials		Description in accordance with clause 3.2.2.5 of ETAG 004 Remain under the ETA holder responsibility			

<sup>1</sup> See clause 3.2 for further description, characteristics and performances of components.

<sup>2</sup> ETA based on ETAG 014 – *Guideline for European Technical Approval of plastic anchors for fixing of external thermal insulation composite systems with rendering*, edition January 2002, amended February 2011.

<sup>3</sup> CARSO 1 and ERALIT are similar materials, only differentiated by the size of aggregates, so tests were performed only for one of them (CARSO 1).

### Design

The user shall comply with the national regulations particularly concerning fire and wind load resistance. Only the components described in clause 1 with characteristics according to clause 3 of this ETA can be used for this ETICS.

The works including the details (such as connections and joints) shall be designed in order to avoid water penetration behind the system. To bond the ETICS, the minimum surface area and the method of bonding shall comply with the characteristics of the ETICS (see 3.2.4 of this ETA) as well as the national regulations. In any case, the minimum bonded surface shall be at least 20%.

## Execution

The recognition and preparation of the substrate as well as the generalities about the execution of the ETICS shall be carried out in compliance with:

- chapter 7 of the ETAG 004, with imperative removal of any existing paint finish or renders which may difficult the bond resistance of the system;
- national regulations.

The particularities in execution linked to the method of bonding and the application of the rendering system shall be handled in accordance with the ETA holder prescriptions. In particular it is suitable to comply with the quantities of rendering applied, the thickness regularity and the drying periods between layers.

## Use, maintenance and repair of the works

It is accepted that the finishing coats shall normally be maintained in order to fully preserve the system's performance. Maintenance will include at least:

- the repair of localized damaged areas due to accidents;
- the application of various products or paints, possibly after washing or surface preparation.

Necessary repairs should be done rapidly. It is important to be able to carry out maintenance as far as possible using readily available products and equipment, without spoiling appearance.

## 3. Performance of the product and references to the methods used for its assessment

### 3.1 General

The identification tests and the assessment for the intended use of this ETICS according to the Basic Requirements were carried out in compliance with the ETA Guideline no. 004: *External Thermal Insulation Composite Systems with Rendering* – edition February 2013 (called ETAG 004, in this ETA).

### 3.2 ETICS characteristics

#### 3.2.1 Mechanical resistance and stability (BWR 1)

Not relevant.

#### 3.2.2 Safety in case of fire (BWR 2)

##### a) Reaction to fire

The reaction to fire was tested according to EN 13823 and EN 11925-2 and classified according to EN 13501-1+A1.

The ETICS meets the requirements of class B-s1,d0 and C-s1,d0 according to EN 13501-1+A1, respectively for finishing coats F1a (PRIMÁRIO TEXTURADO + CARSO 1) and F2 (ARGAMASSA AREADA + PRIMÁRIO CINOLITE HP + NOVATEX HD).

Note: In some Member States, the ETICS classification according to EN 13501-1+A1 might not be sufficient for the use in façades. An additional assessment of ETICS according to national provisions (e.g. on the basis of a large scale test) might be necessary to comply with Member State regulations.

#### 3.2.3 Hygiene, health and environment (BWR 3)

##### a) Water absorption

The results of the water absorption test of the base coat (system with and without finishing), presented in Table 2, verify the following condition:

- water absorption after 1 hour < 1 kg/m<sup>2</sup>

The system is therefore judged to have satisfactory performance concerning water absorption, independently of the finishing coat.

##### b) Hygrothermal behaviour

The ETICS has been assessed on a rig including the thermal insulation and all finishing coats.

During heat-rain and heat-cold cycles, none of the following defects occurs during testing:

- blistering or peeling of the finishings;
- failure or cracking associated with joints between insulation product boards or profiles fitted with the system;
- detachment of render;
- cracking allowing water penetration to the insulation layer.

The ETICS is therefore assessed as resistant to hygrothermal cycles.

c) Freeze / thaw behaviour

The water absorption of the system configurations composed by the base coat and the finishing coat F1a (PRIMÁRIO TEXTURADO + CARSO 1) and by the base coat and the finishing coat F2 (ARGAMASSA AREADA + PRIMÁRIO CINOLITE HP + NOVATEX HD) is respectively less than 0.5 kg/m<sup>2</sup> after 24 hours.

Therefore the classification concerning freeze-thaw resistance is the following:

- configuration “EPS + base coat + standard mesh + finishing coat F1a (PRIMÁRIO TEXTURADO + CARSO 1)” – no test, but freeze-thaw resistant according to the capillarity test result.
- configuration “EPS + base coat + standard mesh + finishing coat F2 (ARGAMASSA AREADA + PRIMÁRIO CINOLITE HP + NOVATEX HD)” – no test, but freeze-thaw resistant according to the capillarity test result.
- any other configuration – performance not assessed.

**TABLE 2**  
Water absorption (capillarity test)

System specimens	Water absorption after 1 h (kg/m <sup>2</sup> )	Water absorption after 24 h (kg/m <sup>2</sup> )
EPS + base coat + standard mesh	0.16	0.24
EPS + base coat + standard mesh + finishing coat F1a (PRIMÁRIO TEXTURADO + CARSO 1)	0.09	0.44
EPS + base coat + standard mesh + finishing coat F2 (ARGAMASSA AREADA + PRIMÁRIO CINOLITE HP + NOVATEX HD)	0.05	0.16

d) Impact resistance

The resistance to hard body impact (3 and 10 Joules) tests carried out on samples of systems compositions lead to the use categories presented in Table 3.

**TABLE 3**  
Impact resistance to hard body impacts

System	Use categories <sup>1</sup>
EPS + base coat + standard mesh	III
EPS + base coat + standard mesh + reinforced mesh	II
EPS + base coat + standard mesh + finishing coat F1a (PRIMÁRIO TEXTURADO + CARSO 1)	II
EPS + base coat + standard mesh + reinforced mesh + finishing coat F1a (PRIMÁRIO TEXTURADO + CARSO 1)	I
EPS + base coat + standard mesh + finishing coat F2 (ARGAMASSA AREADA + PRIMÁRIO CINOLITE HP + NOVATEX HD)	III
EPS + base coat + standard mesh + reinforced mesh + finishing coat F2 (ARGAMASSA AREADA + PRIMÁRIO CINOLITE HP + NOVATEX HD)	III

<sup>1</sup> Use categories:

Category I – zones readily accessible at ground level to the public and vulnerable to hard body impacts but not subjected to abnormally rough use;  
 Category II – zones liable to impacts from thrown or kicked objects, but in public locations where the height of the system will limit the size of the impact; or at lower levels where access to the building is primarily to those with some incentive to exercise care;  
 Category III – zones not likely to be damaged by normal impacts caused by people or by thrown or kicked objects.

e) Water vapour permeability

Table 4 presents the resistance to water vapour diffusion of the rendering system (base coat and finishing coat) for the two system configurations, expressed by the equivalent air thickness. In both cases, values don't exceed 2.0 m.

**TABLE 4**  
Equivalent air thickness

System specimens	Equivalent air thickness (m)
Base coat + standard mesh + finishing coat F1a (PRIMÁRIO TEXTURADO + CARSO 1)	0.72
Base coat + standard mesh + finishing coat F2 (ARGAMASSA AREADA + PRIMÁRIO CINOLITE HP + NOVATEX HD)	0.78

f) Dangerous substances

This system complies with the provisions of Guidance Paper H<sup>2</sup>. A declaration of conformity in this respect was made by the manufacturer. In addition to the specific clauses relating to dangerous substances contained in this ETA, there may be other requirements applicable to the ETICS falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of Regulation (EU) No. 305/11, these requirements need also to be complied with, when and where apply.

### 3.2.4 Safety on use (BWR 4)

a) Bond strength

– Base coat onto EPS board

Tests were performed on the system applied on the rig, after hygrothermal cycles. The results are summarized in Table 5.

In all cases, bond strength values are higher than 0.08 MPa and the failure occurred preferentially in the insulation board (cohesion failure).

**TABLE 5**  
Bond strength between base coat and insulation product

System (rig) <sup>1</sup>	Bond strength (after ageing) (MPa / Failure pattern) <sup>2</sup>
EPS + base coat + standard mesh	0.17 / FP:C/A
EPS + base coat + standard mesh + reinforced mesh	0.15 / FP: C
EPS + base coat + standard mesh + finishing coat F1a (PRIMÁRIO TEXTURADO + CARSO 1)	0.15 / FP: C
EPS + base coat + standard mesh + reinforced mesh + finishing coat F1a (PRIMÁRIO TEXTURADO + CARSO 1)	0.21 / FP: C
EPS + base coat + standard mesh + finishing coat F2 (ARGAMASSA AREADA + PRIMÁRIO CINOLITE HP + NOVATEX HD)	0.20 / FP: C/B
EPS + base coat + standard mesh + reinforced mesh + finishing coat F2 (ARGAMASSA AREADA + PRIMÁRIO CINOLITE HP + NOVATEX HD)	0.21 / FP: C

<sup>1</sup> Rig – system applied on brick masonry with tested dimensions of 3 m × 2 m. The system was subjected to hygrothermal cycles before the adhesion tests.

<sup>2</sup> Failure pattern: FP:A – adhesion failure (failure between adhesive and insulation product), FP:B – cohesion failure (failure in the adhesive) and FP:C – cohesion failure (failure in the insulation product).

<sup>2</sup> Guidance Document H, *A harmonized approach related to dangerous substances under the Construction Products Directive*.

– Adhesive onto EPS board

Tests were performed on samples of EPS insulation boards faced with adhesive. The results are summarized in Table 6. In all cases, the results are within the limits defined by ETAG 004.

**TABLE 6**  
Bond strength between adhesive and insulation product

Specimen	Bond strength (MPa / Failure pattern) <sup>1</sup>		
	Initial state	After conditioning	
		48 h immersion in water + 2 h 23 °C/50 % RH	48 h immersion in water + 7 days 23 °C/50 % RH
EPS + adhesive	0.17 / FP:C	0.12 / FP:C/A	0.17 / FP:C

<sup>1</sup> Failure pattern: FP:A – adhesion failure (failure between adhesive and insulation product) and FP:C – cohesion failure (failure in the insulation product).

– Adhesive onto concrete

Tests were performed on samples of concrete boards faced with adhesive product. The results are summarized in Table 7. In all cases, the results are within the limits defined by ETAG 004.

**TABLE 7**  
Bond strength between adhesive and substrate (concrete)

Specimen	Bond strength (MPa / Failure pattern) <sup>1</sup>		
	Initial state	After conditioning	
		48 h immersion in water + 2 h 23 °C/ 50% RH	48 h immersion in water + 7 days 23 °C/ 50% RH
Adhesive + substrate (concrete)	1.64 / FP:B/A	0.74 / FP:B/A	1.49 / FP:B/A

<sup>1</sup> Failure pattern: FP:A – adhesion failure (failure between adhesive and substrate) and FP:B – cohesion failure (failure in the adhesive).

The minimal bonded surface S is calculated as follows, with a minimum of 20%:

$$S (\%) = [0.03 \times 100] / B$$

where:

B minimum mean failure resistance of the adhesive to the insulation product in dry conditions expressed in MPa (0.17 MPa); 0.03 MPa corresponds to the minimum requirement.

The minimum bonded surface S calculated is therefore 18%.

The bonding surface of 20% verifies the minimum requirement.

b) Wind load resistance

No performance concerning the wind load resistance has been investigated.

### 3.2.5 Protection against noise (BWR 5)

No performance concerning the protection against noise has been investigated.

### 3.2.6 Energy economy and heat retention (BWR 6)

a) Thermal resistance

The additional thermal resistance  $R_{ETICS}$  provided by the ETICS to the substrate wall is calculated in accordance with EN ISO 6946 from the nominal value of the insulation product's thermal resistance  $R_D$  given accompanied to the CE marking and from the thermal resistance of the rendering system  $R_{render}$  which is about 0.02 m<sup>2</sup>.K/W:

$$R_{ETICS} = R_D + R_{render}$$

Thermal bridges caused by mechanical fixing devices influence the thermal transmittance of the entire wall and shall be taken into account.

The corrected thermal transmittance of the entire wall including ETICS and thermal bridges is calculated using the following expression:

$$U_c = U + \chi_p \cdot n$$

where:

$U_c$  corrected thermal transmittance of the entire wall including ETICS and thermal bridges (W/(m<sup>2</sup>.K));

$U$  thermal transmittance of the entire wall including ETICS without thermal bridges (W/(m<sup>2</sup>.K));

$n$  number of anchors (through insulation product) per m<sup>2</sup>;

$\chi_p$  point thermal transmittance value of an anchor (W/K). See EOTA Technical Report TR 025. If not specified in the anchor's ETA, the following values apply:

= 0.002 W/K for anchors with a stainless steel screw with the head covered by plastic material and for anchors with an air gap at the head of the screw ( $\chi_p \cdot n$  negligible for  $n < 20$ );

= negligible for anchors with plastic nails (reinforced or not with glass fibres).

The term  $\chi_p \cdot n$  has only to be taken into account if it is greater than 0.04 W/(m<sup>2</sup>.K).

The thermal transmittance of the entire wall including ETICS without thermal bridges is determined as follows:

$$U = 1 / (R_i + R_{\text{render}} + R_{\text{substrate}} + R_{\text{se}} + R_{\text{si}})$$

where:

$R_i$  thermal resistance of the insulation product (see CE marking in reference to EPS EN 13163) in m<sup>2</sup>.K/W;

$R_{\text{render}}$  thermal resistance of the render (about 0.02 m<sup>2</sup>.K/W);

$R_{\text{substrate}}$  thermal resistance of the substrate (concrete, brick,...) in m<sup>2</sup>.K/W;

$R_{\text{se}}$  external surface resistance in m<sup>2</sup>.K/W;

$R_{\text{si}}$  internal surface resistance in m<sup>2</sup>.K/W.

### 3.2.7 Sustainable use of natural resources (BWR 7)

Performance not assessed.

### 3.2.8 Aspects of durability and serviceability

#### a) Bond strength after ageing

Results of the tests for determining the bond strength between the base coat and the insulation product presented in Table 5 show that in all cases they are higher than 0.08 MPa.

## 3.3 Component characteristics

### 3.3.1 General

Detailed information on the chemical composition and other identifying characteristics of the components, following Annex C of ETAG 004, has been deposited with LNEC.

Further information can be observed from the product data sheets, which are part of the Technical Documentation for this ETA.

### 3.3.2 Insulation product

Factory-prefabricated boards, made of expanded polystyrene (EPS), having the description, characteristics and performance (as minimum) defined in Table 8 (EN 13163).

### 3.3.3 Render

– Render strip tensile resistance

Fatigue tests were performed on specimens to determine the rupture stress of the reinforced render. The results are presented in Table 9.



**TABLE 8**  
Characteristics of insulation panels

Component	Trade name	Characteristics	Declared values and classes	
Insulation product	POLIESTIRENO EXPANDIDO 100	Reaction to fire (EN 13501-1+A1)	Euroclass E Density (EN 1602): $21 \pm 1 \text{ kg/m}^3$ Thickness: 40 to 60 mm	
		Thermal conductivity	0.036 (W/m.K)	
		Classes of dimensional tolerances (EN 13163)	Thickness	Class T(1): $\pm 1 \text{ mm}$
			Length	Class L(2): $\pm 2 \text{ mm}$
			Width	Class W(1): $\pm 1 \text{ mm}$
			Squareness	Class S(1): $\pm 1 \text{ mm/m}$
			Flatness	Class P(3): $\pm 3 \text{ mm}$
		Compressive strength (EN 13163)	110 kPa	
		Flexural strength (EN 13163)	150 kPa	
		Dimensional stability under laboratory condition (EN 13163)	$\leq 1.0 \%$	
		Water absorption (partial immersion) (EN 1609)	$0.04 \pm 0.01 \text{ kg/m}^2$	
		Water vapour diffusion resistance factor (EN 12086)	$39 \pm 3$	
Tensile strength perpendicular to the faces (EN 1607)	$242 \pm 10 \text{ kPa}$			
Shear strength and shear modulus of elasticity (EN 12090)	Shear strength: $130 \pm 10 \text{ kPa}$ Shear modulus of elasticity: $2300 \pm 100 \text{ kPa}$			

**TABLE 9**  
Results of render strip tensile test

System specimen	Characteristics	Test results
Base coat + standard mesh	Tensile strength (N/mm)	23
	Tensile strength while the first crack is formed (N/mm)	12
	Crack width at relative elongation (mm)	0.04

### 3.3.4 Glass fibre meshes

The characteristics of the glass fibre meshes are presented in Table 10.

### 3.3.5 Anchors

Anchors for expanded polystyrene panels act as supplementary fixing if required. They are covered by ETA 04/0030, according to ETAG 014 "Plastic anchors for fixing external thermal insulation composite systems with rendering" (see Table 1).

Their main characteristics and design data are presented in Table 11.

**TABLE 10**  
Results of meshes tensile test

Component	Trade name	Characteristics	Test results
Standard mesh	FAST TELA F167	Tensile strength after accelerated artificial ageing (N/mm)	20 ( $\geq 20$ )
		Relative residual resistance: % (after ageing) of the strength in the as delivered state	61 ( $> 50$ )
		Mass per surface unit (g/m <sup>2</sup> )	160 ( $\pm 5$ %)
		Mesh dimensions (mm $\times$ mm)	5 $\times$ 4 ( $\pm 5$ %)
Reinforced mesh	FAST TELA F300	Tensile strength after accelerated artificial ageing (N/mm)	38 ( $> 20$ )
		Relative residual resistance: % (after ageing) of the strength in the as delivered state	67 ( $> 50$ )
		Mass per surface unit (g/m <sup>2</sup> )	330 ( $\pm 5$ %)
		Mesh dimensions (mm $\times$ mm)	6 $\times$ 6 ( $\pm 5$ %)

**TABLE 11**  
Description and characteristics of anchors

Component	Trade name	Characteristics	Declared values and design data
Anchors	PREGO DE FIXAÇÃO TDS 8	Anchor type	See dimensional characteristics in Table 2 of Annex 3 of ETA 04/0030
		Materials	Anchor (expansion sleeve): polypropylene Nail: galvanized and inoxidable steel
		Resistance to tension loads (kN)	0.3 – 0.8 (see ETA 04/0030)
		Spacing (mm)	$\geq 100$
		Edge distance (mm)	$\geq 100$
		Thickness of the substrate (mm)	$\geq 100$

#### 4. Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

According to the decision 97/556/EC of the European Commission of 14 July 1997<sup>3</sup>, as amended by the decision 2001/596/EC<sup>4</sup> of 8 January of 2001, and considering the classes B and C for the reaction to fire of the ETICS and that no stage in the production process has been identified that could result in an improvement of the reaction to fire characteristic, the system of assessment and verification of constancy of performance (see Annex V, as amended by Commission Delegated Regulation no. 568/2014 of 18 February 2014, and article 65, paragraph 2 of Regulation (EU) No. 305/2011) given in Table 12 applies.

**TABLE 12**  
System of assessment and verification of constancy of performance

Product	Intended uses	Levels or classes	System
CIN-k EPS Classic	External thermal insulation composite system with rendering for use on building walls	Any	2+

<sup>3</sup> Official Journal of the European Communities L229/14 of 20.08.1997.

<sup>4</sup> Official Journal of the European Communities L229/33 of 02.08.2001.

This system of assessment and verification of constancy of performance +2 is defined as follows:

System 2+: Declaration of the performance of the essential characteristics of the construction product by the manufacturer on the basis of:

- a) Tasks for the manufacturer:
  - (1) factory production control;
  - (2) testing of samples taken at the factory in accordance with the prescribed test plan.
- b) Tasks for the notified factory production control certification body:
  - (3) decision on the issuing, restriction, suspension or withdrawal of the certificate of conformity of the factory production control on the basis of the outcome of the following assessments and verifications carried out by that body:
    - initial inspection of the manufacturing plant and of factory production control;
    - continuous surveillance, assessment and evaluation of factory production control.

## **5. Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD**

### **5.1 General**

The ETA is issued on the basis of agreed data/information, deposited with LNEC, which identifies the product that has been assessed and judged. It is the manufacturer's responsibility to make sure that all those who use the kit are appropriately informed of the specific conditions laid down in this ETA, including its annexes.

Changes to the ETICS or the components or their production process should be notified to LNEC before the changes are introduced. LNEC will decide whether or not such changes affect the ETA and if so whether further assessment or alterations to the ETA shall be necessary.

### **5.2 Tasks for the manufacturer**

#### **Factory production control**

The manufacturer shall exercise permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer shall be documented in a systematic manner in the form of written policies and procedures, including records of results performed.

This production control system shall ensure that the product is in conformity with this ETA.

The manufacturer may only use components stated in the technical documentation of this ETA. The incoming raw materials are subjected to verifications by the manufacturer before acceptance.

For the components of the ETICS which the manufacturer does not manufacture by himself, he shall make sure that the factory production control carried out by the other manufacturers gives the guarantee of the components compliance with the ETA.

The factory production control shall be in accordance with the Control Plan<sup>5</sup>, which is part of the Technical Documentation of this ETA. The control plan has been agreed between the manufacturer and the LNEC and is laid down in the context of the factory production control system operated by the manufacturer and deposited within LNEC. The results of factory production control shall be recorded and evaluated in accordance with the provisions of the control plan.

#### **Other tasks for the manufacturer**

The manufacturer shall, on the basis of a contract, involve a body (bodies) which is (are) notified for the tasks referred to in section 4 in the field of ETICS in order to undertake the actions laid down in this clause. For this purpose, the control plan shall be handed over by the manufacturer to the notified body (bodies) involved.

For assessing the ETICS and the components the results of the tests performed as part of the assessment for the ETA shall be used unless there are changes in the production line or plant. In such cases the necessary testing has to be agreed with LNEC.

The declaration of performance of the ETICS to be drawn up by the manufacturer following the issuing of this ETA shall include its reference number and issuing date.

Changes to the ETICS or the components or their production process should be notified to LNEC before the changes are introduced. LNEC will decide whether or not such changes affect the ETA and if so whether further assessment or alterations to the ETA shall be necessary.

<sup>5</sup> The control plan is a confidential part of this European Technical Assessment and is only handed over to the notified body or bodies involved in the procedure of assessment and verification of constancy of performance. See section 5.3.

### 5.3 Tasks for the notified body (bodies)

Within the scope of the initial inspection of factory and of factory production control, the notified body (bodies) shall ascertain that, in accordance with the Control Plan, the factory (in particular the employees and the equipment) and the factory production control are suitable to ensure continuous and orderly manufacturing of the components according to the specifications mentioned in this ETA.

Within the scope of continuous surveillance, assessment and evaluation of factory production control, the notified body (bodies) shall visit the factory at least once a year for surveillance. It has to be verified that the factory production control is maintained in suitable conditions.

These tasks shall be performed in accordance with the provisions laid down in the control plan.

The notified body (bodies) shall retain the essential points of its (their) actions referred to above and state the results obtained and conclusions drawn in a written report.

The notified body involved by the manufacturer shall issue a certificate of conformity of the factory production control stating the conformity with the provisions of this ETA.

In cases where the provisions of the ETA and its control plan are no longer fulfilled, the notified certification body shall withdraw the certificate of conformity and inform LNEC without delay.

Issued in Lisbon on 04/07/2016

By


Laboratório Nacional de Engenharia Civil (LNEC)

The Board of Directors

A handwritten signature in blue ink, appearing to read 'Carlos Pina', is written over a horizontal line.

Carlos Pina  
President


## Annex 1

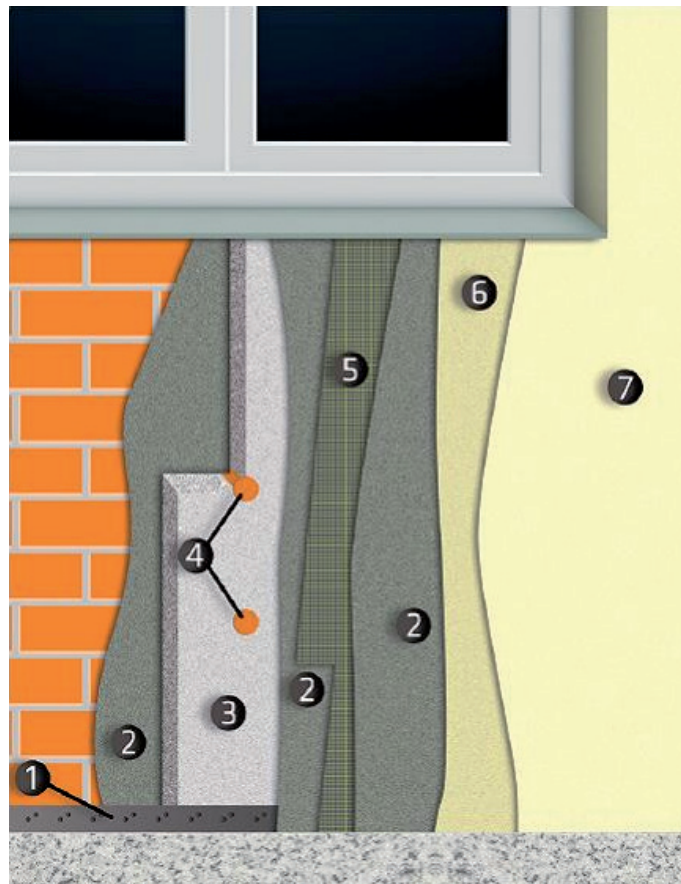

- 1 End profile
- 2 PRINCOL ARGAMASSA FIBRADA
- 3 POLIESTIRENO EXPANDIDO 100
- 4 PREGO DE FIXAÇÃO TDS 8
- 5 FAST TELA F167
- 6 PRIMÁRIO TEXTURADO or ARGAMASSA AREADA  
and PRIMÁRIO CINOLITE HP
- 7 CARSO 1 or ERALIT or NOVATEX HD

ETICS general aspect and components

## Annex 2

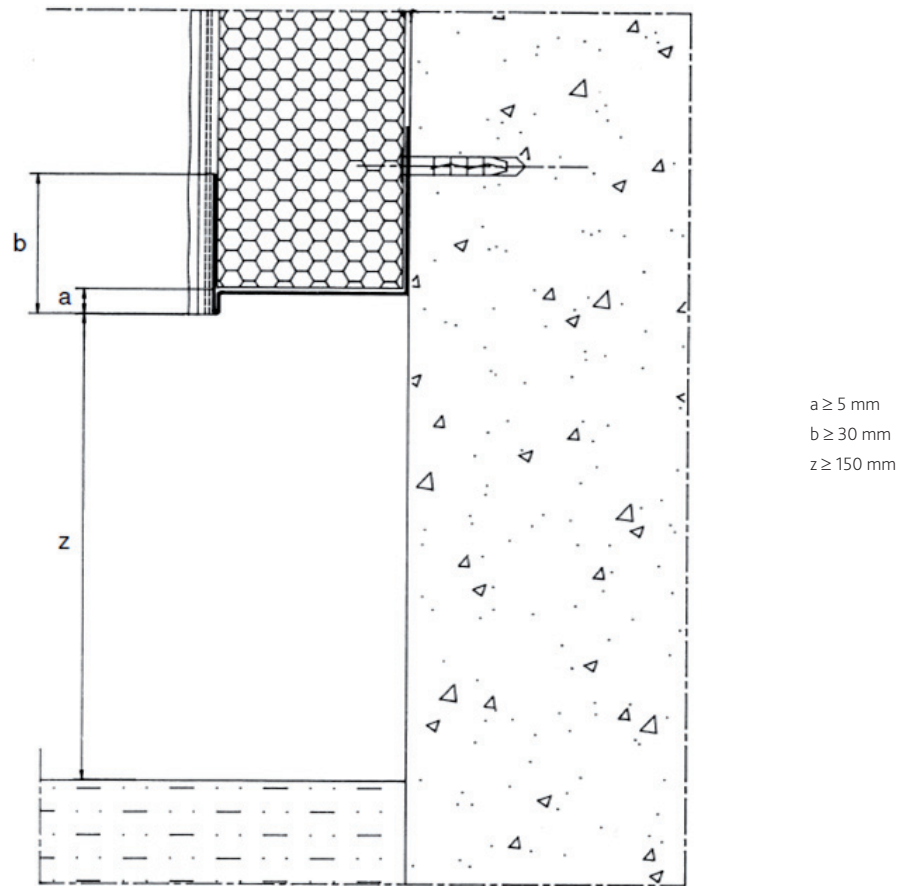

Vertical section of ETICS start

